


DATE: 07.02.14

Performance Criteria: Sound Insulation**Applicable Standards:** BS EN ISO 10140-2: 2010; ISO 717-1:1996**System:** Revolution 54**Configuration:** 12.8mm Acoustic Laminate + 12.8mm Acoustic Laminate**Description:** Double glazed screen comprising multiple modules of 12.8mm acoustic laminated glass on one face and 12.8mm acoustic laminated glass on the other, installed into aluminium track sections with glass sealed into tracks with PVC gaskets and between panels with Optima Nebula™ dry-joints**Test Date:** 28.01.11**Test Report Number:** 33-160**Test Specimen Area:** 8.64m²**Test Data:**

Frequency (Hz)	R (dB) screen	R (dB) door
100	30.7	~
125	29.0	~
160	27.2	~
200	28.6	~
250	30.2	~
315	32.4	~
400	39.0	~
500	42.3	~
630	44.1	~
800	44.2	~
1000	49.2	~
1250	51.9	~
1600	52.3	~
2000	56.9	~
2500	62.4	~
3150	64.2	~

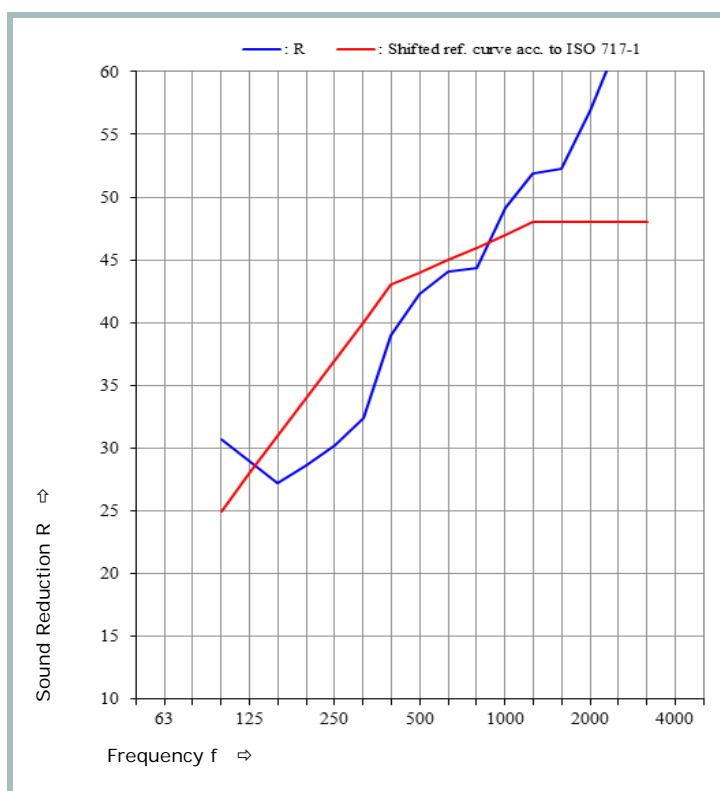

Third Octave Band

Weighted Sound Reduction Index**R_w (C;Ctr) 44 (-2;-6) dB**

Independently tested at UKAS accredited acoustic test laboratory

Issued By:**Position:**

Technical Product Manager

To validate this certified performance the system installation must be carried out in strict accordance with the details summarised in the Optima Designer's Guide and Installer's Guide.